


| PART NUMBER | SIZE              | "R" | "O" | "H" | "S" MIN           | "B" MIN           | "L"                |
|-------------|-------------------|-----|-----|-----|-------------------|-------------------|--------------------|
| 5236338     | 1"                | 48" | 48" | 48" | 1 $\frac{7}{8}$ " | 1 $\frac{1}{2}$ " | 75 $\frac{3}{8}$ " |
| 5234053     | 1 $\frac{1}{4}$ " | 48" | 48" | 48" | 2"                | 1 $\frac{1}{2}$ " | 75 $\frac{3}{8}$ " |
| 5233865     | 1 $\frac{1}{2}$ " | 48" | 48" | 48" | 2"                | 2"                | 75 $\frac{3}{8}$ " |
| 5233876     | 2"                | 48" | 48" | 48" | 2"                | 2"                | 75 $\frac{3}{8}$ " |
| 5233849     | 2 $\frac{1}{2}$ " | 48" | 48" | 48" | 3"                | 2 $\frac{1}{4}$ " | 75 $\frac{3}{8}$ " |
| 5233817     | 3"                | 48" | 48" | 48" | 3 $\frac{1}{8}$ " | 2 $\frac{1}{2}$ " | 75 $\frac{3}{8}$ " |
| 5233892     | 3 $\frac{1}{2}$ " | 48" | 48" | 48" | 3 $\frac{1}{4}$ " | 3 $\frac{1}{4}$ " | 75 $\frac{3}{8}$ " |
| 5233843     | 4"                | 48" | 48" | 48" | 3 $\frac{3}{8}$ " | 3 $\frac{1}{4}$ " | 75 $\frac{3}{8}$ " |
| 5233868     | 5"                | 48" | 48" | 48" | 3 $\frac{5}{8}$ " | 4 $\frac{1}{4}$ " | 75 $\frac{3}{8}$ " |
| 5233816     | 6"                | 48" | 48" | 48" | 3 $\frac{3}{4}$ " | 5"                | 75 $\frac{3}{8}$ " |



ETL LISTED  
 CONFORMS TO UL651  
 ETL CONTROL #3107144  
 CONFORMS TO NEMA TC3  
 SEE NEC ARTICLE 352 FOR USE  
 MATERIAL IS RIGID PVC  
 BEND TOLERANCE IS  $\pm 2^\circ$   
 "B" TOLERANCE IS  $-\frac{1}{8}$ ",  $+\frac{1}{2}$ "

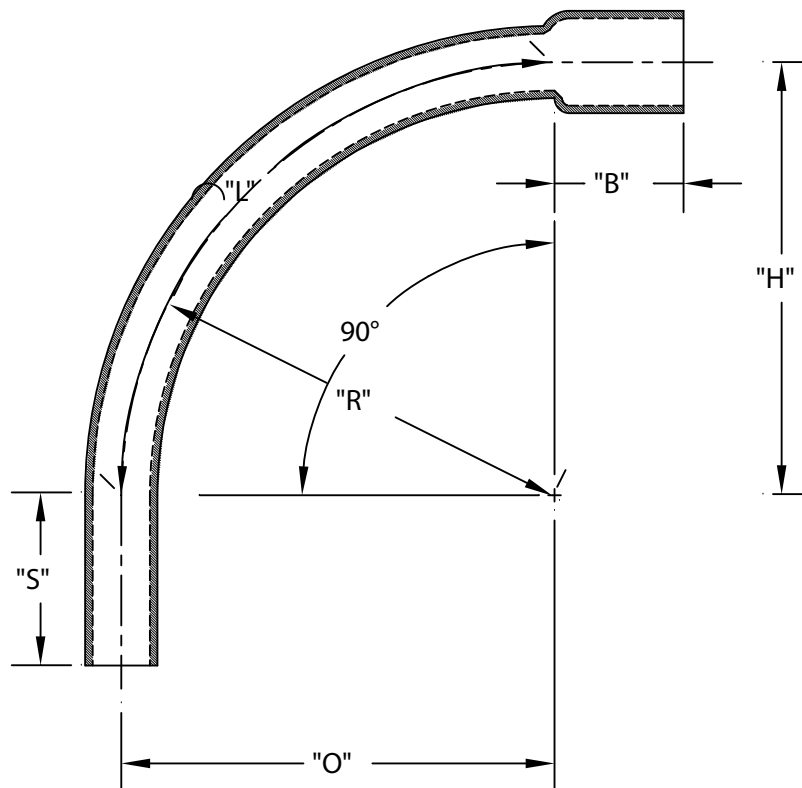

**CANTEX**  
 INC.  
 Fort Worth, TEXAS


90° Elbows Bell End  
 Schedule 40 48" Radius Elbows

Drawn By: CD Branch

Date: 10/15/07

Ref.

| PART NUMBER | SIZE              | "R" | "O" | "H" | "S" MIN           | "B" MIN           | "L"                |
|-------------|-------------------|-----|-----|-----|-------------------|-------------------|--------------------|
| 5236338     | 1"                | 48" | 48" | 48" | 1 $\frac{7}{8}$ " | 1 $\frac{1}{2}$ " | 75 $\frac{3}{8}$ " |
| 5234053     | 1 $\frac{1}{4}$ " | 48" | 48" | 48" | 2"                | 1 $\frac{1}{2}$ " | 75 $\frac{3}{8}$ " |
| 5233865     | 1 $\frac{1}{2}$ " | 48" | 48" | 48" | 2"                | 2"                | 75 $\frac{3}{8}$ " |
| 5233876     | 2"                | 48" | 48" | 48" | 2"                | 2"                | 75 $\frac{3}{8}$ " |
| 5233849     | 2 $\frac{1}{2}$ " | 48" | 48" | 48" | 3"                | 2 $\frac{1}{4}$ " | 75 $\frac{3}{8}$ " |
| 5233817     | 3"                | 48" | 48" | 48" | 3 $\frac{1}{8}$ " | 2 $\frac{1}{2}$ " | 75 $\frac{3}{8}$ " |
| 5233892     | 3 $\frac{1}{2}$ " | 48" | 48" | 48" | 3 $\frac{1}{4}$ " | 3 $\frac{1}{4}$ " | 75 $\frac{3}{8}$ " |
| 5233843     | 4"                | 48" | 48" | 48" | 3 $\frac{3}{8}$ " | 3 $\frac{1}{4}$ " | 75 $\frac{3}{8}$ " |
| 5233868     | 5"                | 48" | 48" | 48" | 3 $\frac{5}{8}$ " | 4 $\frac{1}{4}$ " | 75 $\frac{3}{8}$ " |
| 5233816     | 6"                | 48" | 48" | 48" | 3 $\frac{3}{4}$ " | 5"                | 75 $\frac{3}{8}$ " |

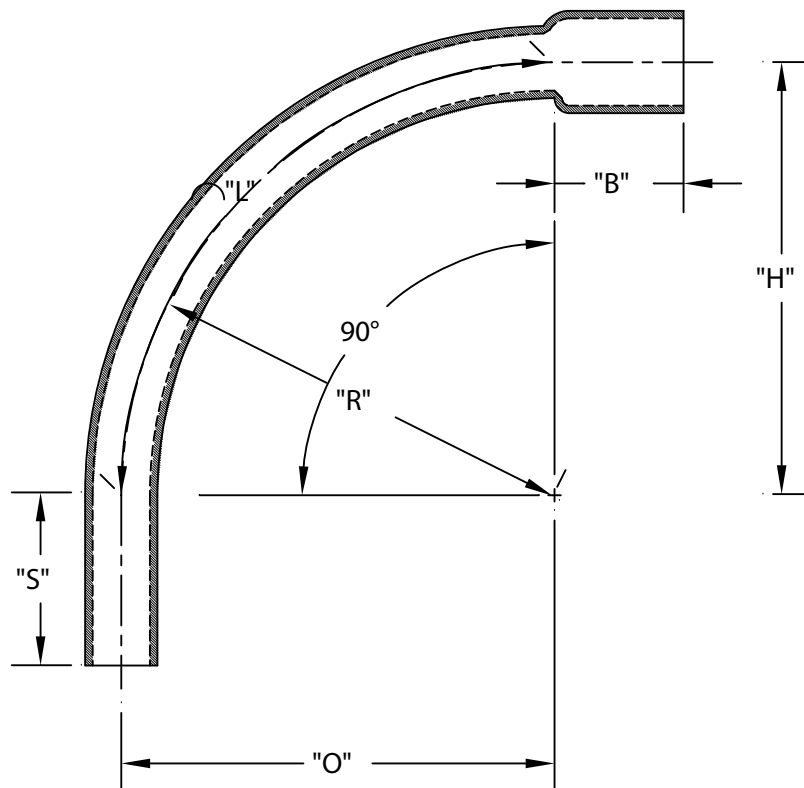

ETL LISTED  
 CONFORMS TO UL651  
 ETL CONTROL #3107144  
 CONFORMS TO NEMA TC3  
 SEE NEC ARTICLE 352 FOR USE  
 MATERIAL IS RIGID PVC  
 BEND TOLERANCE IS  $\pm 2^\circ$   
 "B" TOLERANCE IS  $-\frac{1}{8}$ ",  $+\frac{1}{2}$ "



**CANTEX**  
 INC.  
 Fort Worth, TEXAS

90° Elbows Bell End  
 Schedule 40 48" Radius Elbows

Drawn By: CD Branch

Date: 10/15/07

Ref.